

Este reporte contiene información muy importante de su salud y el agua que toma. Tradúzcalo por favor ó hable con alguien que lo entienda bien.

Este relatório contém informações importantes sobre sua água potável. Por favor traduza-o ou fale com alguém que entenda o que está escrito.

*Mabalaga ang impormasyong ito.
Mangyaring ipasalin ito.*

Dieser Report enthält wichtige Informationen über Ihr Trinkwasser. Übersetzen Sie ihn bitte oder sprechen Sie mit jemand, das ihn versteht.

Ce rapport contient de l'information importante concernant votre eau potable. Veuillez le traduire, ou parlez-en avec quelqu'un qui le comprend.

此份有關你的食水報告,內有重要資料和訊息,請找他人為你翻譯及解釋清楚。

Chi tiet này thật quan trọng.
Xin nhờ người dịch cho quý vị.

यह सूचना महत्वपूर्ण है ।
कृपा करके किसी से :सका अनुवाद करायें ।

このレポートはあなたの飲料水に関する重要な情報が含まれています。
翻訳するか、レポートの内容を理解できる方に説明してもらってください。

이 안내는 매우 중요합니다.
본인을 위해 번역인을 사용하십시오.

Данный рапорт содержит важную информацию о вашей питьевой воде. Переведите его или проконсультируйтесь с тем, кто его понимает.

این اطلاعیه شامل اطلاعات مهمی راجع به آب آشامیدنی است. اگر نمی‌توانید این اطلاعات را به زبان انگلیسی بخوانید لطفاً از کسی که می‌تواند تباری بگیرد تا مطالب را برای شما به فارسی ترجمه کند.

”هذا التقرير يحتوي على معلومات مهمة تتعلق بمياه الشفة (أو الشرب).“

ترجم التقرير, أو تكلم مع شخص يستطيع أن يفهم التقرير.

ਇਸ ਰਿਪੋਰਟ ਵਿਚ ਤੁਹਾਡੇ ਪੀਣ ਵਾਲੇ ਪਾਣੀ ਵਾਰੇ ਬਹੁਤ ਜ਼ਰੂਰੀ
ਸੂਚਨਾ ਹੈ। ਇਸ ਨੂੰ ਪੜ੍ਹੋ ਜਾਂ ਜੋ ਸਮਝ ਇਸ ਨੂੰ ਸਮਝ ਸਕਦੇ ਹਨ,
ਉਸ ਵੇਲੇ ਸਮਝੋ।



43885 South Grimmer Blvd.
Fremont, CA 94538

PRESORTED STANDARD
U.S. POSTAGE
PAID
PERMIT NO. 2
HAYWARD CA

2012 WATER QUALITY REPORT

Dear ACWD Customer:

This report summarizes the results of the thousands of analyses conducted on your drinking water during 2012. I'm pleased to report that your water consistently met or surpassed all federal and state drinking water standards for public health and safety over the course of the year. To learn more about the quality of your drinking water, turn to the following pages:

Information for the Immuno-Compromised.....	2
Comprehensive Water Quality Monitoring.....	2
Drinking Water Source Assessment.....	2
2012 Water Quality Tables.....	3-4
A Note about Lead.....	5
Frequently Asked Questions about Disinfection Byproducts.....	5
Public Health Goals Report.....	5
Quarry Lakes Lead Tackle Exchange Program.....	5
Where Our Water Comes From.....	6
Your Views are Welcome.....	6

Walt Wadlow
General Manager

A MESSAGE FROM THE USEPA AND THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH

A Note about Drinking Water

All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. These contaminants enter water as it travels over the surface of the land or through the ground, dissolving substances that are naturally present in the environment or picking up substances resulting from the presence of animals or human activity. The presence of contaminants does not necessarily indicate that water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (USEPA) and the California Department of Public Health (CDPH) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. Department regulations also establish limits for contaminants in bottled water that must provide the same protection for public health. CDPH regulations are in many cases more stringent than federal ones. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (800-426-4791).

A Note to the Immuno-compromised

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

COMPREHENSIVE WATER QUALITY MONITORING

ACWD works diligently to ensure that your water complies with all state and federal drinking water standards. This is a comprehensive effort that includes monitoring and testing for many types of contaminants that may be present in source water (i.e., water before treatment), including:

- Microbials, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganics, such as salts and metals, that can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- Organic chemicals, including synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, or that may come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- Radioactive contaminants, that can be naturally occurring or be the result of oil and gas production and mining activities.

Highly trained analysts and water treatment plant operators in our state-certified laboratory and satellite laboratories are committed to conducting these tests under a stringent Quality Assurance/Quality Control (QA/QC) program.

Through written procedures, work instructions, and detailed record maintenance, the QA/QC program ensures the quality of the analytical data produced by our laboratories. ACWD staff members collect samples daily from the water sources, treatment facilities, and distribution system to ensure the high quality of the water you drink.




Water samples collected at ACWD water treatment plants, such as the Newark Desalination Facility, are analyzed by state-certified laboratory chemists and technicians.

DRINKING WATER SOURCE ASSESSMENT

In response to 1996 federal Safe Drinking Water Act amendments, California was required to implement a Source Water Assessment program. Drinking Water Source Assessments are conducted to determine how vulnerable drinking water sources are to contamination. Assessments have been completed for all of ACWD's water sources.

- The San Francisco Public Utilities Commission (SFPUC), which administers the Hetch Hetchy system, completed its assessment in 2000. It was found that SFPUC watersheds are vulnerable to contaminants associated with wildlife and, to a limited extent, human recreational activity. Historically, the levels of contaminants have been very low in the watersheds.
- The South Bay Aqueduct (SBA) source assessment was completed in 2002. This source is most vulnerable to agricultural drainage, wastewater treatment plant discharges, urban runoff, recreational activity, and cattle grazing. In addition, seawater intrusion contributes salt and bromide to the water supply.
- ACWD's assessment of local groundwater sources was also completed in 2002. These sources are most vulnerable to existing and historic gas stations, known contaminant plumes, confirmed leaking underground storage tanks, dry cleaners, metal plating/finishing/fabricating, and sewer collection.

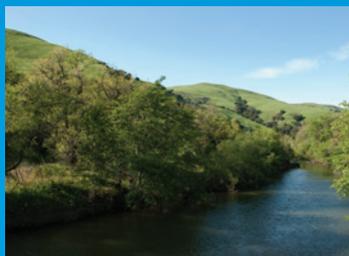

Drinking Water Source Assessments have been completed for all of ACWD's water sources, including those portions of the Alameda Creek watershed administered by the San Francisco Public Utilities Commission.

Although ACWD water sources are vulnerable to potentially contaminating activities, our treatment and blending facilities purify your tap water to the strict standards set by federal and state regulatory agencies. Complete assessments may be reviewed at ACWD headquarters located at 43885 South Grimmer Boulevard in Fremont. To have a summary of the assessments sent to you, please call Laura Hidas, Water Supply Supervisor, at (510) 668-6516.

2012 WATER QUALITY INFORMATION

In 2012, the laboratory analysts and water treatment plant operators in ACWD's state-certified laboratories and satellite laboratories analyzed for more than 180 substances and found very few of them in your water. In all cases, your water was in compliance with federal and state standards for public health and safety. There are two types of standards ACWD is required to meet:

Primary Drinking Water Standards set limits for substances in water that may be harmful to humans if consumed in excess. They include MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Secondary Drinking Water Standards deal with aesthetic qualities such as taste and odor which relate to consumer acceptance rather than health factors.

A summary of key results for 2012 is presented in the following tables. Technical terms and abbreviations used in the tables are explained below.

DEFINITIONS

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically or technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Notification Level (NL): CDPH health-based advisory levels used to provide information to public water systems and others about unregulated contaminants in drinking water. Unregulated contaminant monitoring helps the EPA and the CDPH to determine where certain contaminants occur and whether the contaminants need to be regulated.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

ABBREVIATIONS

mg/L: Milligrams per liter (which is equal to parts per million).

µg/L: Micrograms per liter (which is equal to parts per billion).

ppm: Parts per million (which is equal to milligrams per liter).

ppb: Parts per billion (which is equal to micrograms per liter).

pCi/L: Picocuries per liter (a measure of radioactivity).

µmhos/cm: Micromhos/centimeter.

NTU: Nephelometric turbidity units.

TON: Threshold Odor Number

ND: The substance could not be found at the minimum amount that can be detected.

NA: Not Applicable.

PRIMARY DRINKING WATER STANDARDS

Parameters	Units	Primary MCL or [MRDL]	{PHG} (MCLG) or [MRDLG]	Treated Surface Water ⁽¹⁾		Purchased San Francisco Water ⁽¹⁾		Blended Water ⁽¹⁾		Desalinated Water ⁽¹⁾		Major Sources
				Range	Average	Range	Average or [Max.]	Range	Average	Range	Average	
Fluoride (naturally occurring) ⁽²⁾	ppm	2	{1}	ND		0.8 - 1.1	1.0	0.14 - 0.24	0.19	ND - 0.22	ND	Erosion of natural deposits
Fluoride (treated water) ⁽³⁾	ppm	2	{1}	Average = 0.9 (Range 0.7 - 1.2)								Water additive that promotes strong teeth
Bromate	ppb	10	{0.1}	Highest RAA ⁽⁴⁾ = ND (Range of individual detections: ND - 1.5)								Disinfection by-product
Disinfectant Residual (as Cl ₂) ⁽⁵⁾	ppm	{4}	{4}	Annual Average ⁽⁶⁾ = 1.9 (Range of individual detections: ND - 2.9)								Disinfectant residual
Gross Alpha	pCi/L	15	0	ND - 3.7	ND	ND		ND		ND		Erosion of natural deposits
5 Haloacetic Acids (HAA5) ⁽⁷⁾	ppb	60	NA	Highest RAA = 16 (Range of individual detections: ND - 36) ⁽⁸⁾								Disinfection by-product
Nitrate (as NO ₃)	ppm	45	{45}	ND - 5.7	2.9	ND		ND - 2.7	1.2	3.0 - 3.5	3.2	Runoff from fertilizer use; erosion of natural deposits
Nitrate + Nitrite (as Nitrogen N)	ppm	10	{10}	ND - 1.3	0.7	ND		ND - 0.7	0.4	0.7 - 0.8	0.7	Runoff from fertilizer use; erosion of natural deposits
Radium-226	pCi/L	5	{0.05}	ND		1.9		ND		ND		Erosion of natural deposits
Total Trihalomethanes (TTHMs) ⁽⁹⁾	ppb	80	NA	Average = 21 (Range of individual detections: ND - 64) ⁽⁸⁾								Disinfection by-product
Turbidity ⁽¹⁰⁾	NTU	TT = 0.1-0.3 ⁽¹¹⁾	NA	ND - 0.26	0.03	NA	NA	Not subject to the turbidity monitoring requirement				Soil runoff
		TT = 5.0 ⁽¹²⁾	NA	NA	NA	0.2 - 0.50 ⁽¹³⁾	{2.8} ⁽¹⁴⁾					

Lead and Copper Sampling Program ⁽¹⁵⁾	Units	Action Level ⁽¹⁶⁾	{PHG}	Range	90th Percentile Value	Number of Samples Collected	Number of Samples above AL	Typical Sources in Drinking Water
Copper ⁽¹⁷⁾	ppm	1.3	{0.3}	ND - 0.8	0.5	73	0	Corrosion of household plumbing systems

SECONDARY DRINKING WATER STANDARDS

Parameters	Units	Secondary MCL	Treated Surface Water		Purchased San Francisco Water		Blended Water		Desalinated Water		Major Sources
			Range	Average	Range	Average	Range	Average	Range	Average	
Chloride	ppm	500	54 - 120	95	3.3 - 4.8	4.1	45 - 66	52	60 - 66	62	Runoff/leaching from natural deposits; seawater influence
Color	units	15	ND - 10	3	ND		ND		ND		Naturally-occurring organic materials
Iron	ppb	300	ND		ND - 120	ND	ND		ND		Leaching from natural deposits; industrial wastes
Manganese	ppb	50	ND - 27	ND	ND		ND		ND		Leaching from natural deposits
Odor	TON	3	ND - 2	ND	ND		ND		ND		Naturally-occurring organic materials
Specific Conductance	µS / cm	1,600	349 - 667	556	52 - 67	61	408 - 547	519	398 - 439	409	Substances that form ions when in water; seawater influence
Sulfate	ppm	500	19 - 69	44	3.8 - 4.4	4.2	42 - 50	45	20 - 23	21	Naturally occurring minerals
Total Dissolved Solids	ppm	1,000	180 - 380	303	34 - 40	38	260 - 310	290	210 - 230	218	Naturally occurring minerals and metals

OTHER WATER QUALITY PARAMETERS

Parameters	Units	NL	Treated Surface Water		Purchased San Francisco Water		Blended Water		Desalinated Water		Major Sources
			Range	Average	Range	Average	Range	Average	Range	Average	
Alkalinity	ppm as CaCO ₃	NA	52 - 102	81	ND - 24	17	119 - 154	133	78 - 89	82	Naturally occurring minerals
Calcium	ppm	NA	14 - 27	22	4.8 - 5.9	5.3	25 - 40	32	15 - 17	16	Naturally occurring mineral
Hardness ⁽¹⁸⁾	ppm as CaCO ₃	NA	72 - 142	114	18 - 22	21	128 - 170	148	70 - 78	73	Naturally occurring minerals
Magnesium	ppm	NA	8.9 - 17	14	0.9 - 1.3	1.1	14 - 19	16	7.4 - 9.2	7.9	Naturally occurring mineral
pH	units	NA	8.5 - 8.9	8.7	9.4 - 9.5	9.4	8.0 - 8.4	8.2	8.6 - 8.9	8.8	Naturally occurring minerals
Potassium	ppm	NA	1.8 - 3.6	2.9	ND - 0.4	0.2	1.4 - 2.1	1.7	ND - 0.7	0.4	Naturally occurring mineral
Sodium	ppm	NA	41 - 80	67	5.5 - 8.0	6.5	49 - 58	53	54 - 63	57	Naturally occurring mineral

(1) Refer to the "Distribution System Map" (page 6) to determine the type of water you typically receive based on your location.

(2) Fluoride in purchased San Francisco water includes both naturally-occurring fluoride and fluoride added by San Francisco to the regional supply upstream of ACWD.

(3) ACWD treats your water by adding fluoride to the naturally occurring level in order to help prevent dental caries in consumers. The fluoride levels in treated water are maintained within a range of 0.8 - 1.4 ppm, as required by State regulations.

(4) Compliance is based on a running annual average (RAA) of 12 monthly samples.

(5) Disinfectant residual in the distribution system consists of combined chlorine (chloramines); results are reported as Total Combined Chlorine.

(6) For disinfectant residual the annual average for 2012 is reported.

(7) Five Haloacetic Acids is the sum of monochloroacetic acid, dichloroacetic acid, trichloroacetic acid, monobromoacetic acid, and dibromoacetic acid.

(8) The average presented is the average of all distribution system samples collected in Quarter 1 2012 under Stage 1 DBP Rule compliance. The range is based on all distribution system samples collected during 2012 (including under Stage 2 DBP compliance in Quarters 2-4 2012).

(9) Total Trihalomethanes is the sum of chloroform, bromodichloromethane, dibromochloromethane, and bromoform.

(10) Turbidity is a measure of the cloudiness of water. It is used to indicate water quality and filtration effectiveness. Turbidity is measured in NTUs (nephelometric turbidity units).

(11) Treatment Technique performance standard: 0.1 NTU for filtered water in 95% of the measurements from MSJWTP taken at 15-minute inter-

vals each month and shall not exceed 1.0 NTU at any time. 0.3 NTU for filtered water in 95% of the measurements from WTP2 taken at 15-minute intervals each month and shall not exceed 1.0 NTU at any time. The lowest monthly percentage of samples meeting the turbidity limits was 99.93% for MSJWTP and 100% for WTP2.

(12) Treatment Technique performance standard: 5 NTU for unfiltered water. The purchased SFPUC water met this standard 100% of the time during 2012.

(13) Turbidity is measured every four hours. There are monthly average turbidity values.

(14) No average value was reported by the SFPUC. The highest turbidity for unfiltered water reported by the SFPUC was 2.8 NTU but it was not observed upstream in SFPUC's San Joaquin pipelines.

(15) In compliance with federal Lead and Copper Program requirements, 1 liter samples are taken by consumers from within their homes after a 6 to 8 hour stagnation period.

(16) Compliance is based on 90th percentile values, which should be less than the action level (AL).

(17) Due to consistently low sampling results, CDPH approved reduced lead and copper monitoring frequency to once every 3 years. Results reported here were collected by ACWD in 2012. In 2012 the 90th percentile lead value was ND.

(18) For customers who want to know their hardness value in grains per gallon (gpg), divide the provided hardness value by 17.1

FREQUENTLY ASKED QUESTIONS ABOUT DISINFECTION BYPRODUCTS

- Q.** What are disinfection byproducts?
- A.** Disinfection byproducts are chemicals formed when chlorine reacts with organic matter in water. Excessive levels of these chemicals, which include trihalomethanes (THMs) and haloacetic acids (HAAs), may pose long-term health hazards.
- Q.** Why is chlorine added to water if it helps to form disinfection byproducts?
- A.** Chlorine kills germs that could be harmful to your health and helps to ensure that your tap water is safe to drink. In fact, adding chlorine to drinking water has been so successful in eliminating waterborne diseases such as cholera and typhoid fever that most of us take the safety and purity of our water for granted.
- Q.** Does the government regulate disinfection byproducts?
- A.** Yes. The U.S. Environmental Protection Agency and California Department of Public Health have established limits on the amount of disinfection byproducts that can be found in drinking water. These limits help to ensure that these chemicals will not harm your health.
- Q.** Does ACWD meet current state and federal regulations for disinfection byproducts?
- A.** Yes. ACWD regularly tests for disinfection byproducts at monitoring sites throughout the Tri-City area. In order to meet current government regulations, the running annual average of THMs and HAAs at each of these sites must fall below their respective Maximum Contaminant Levels. As shown in the data tables in this report, both THM and HAA levels fell well within the acceptable range.



ACWD regularly tests for disinfection byproducts at monitoring sites throughout the Tri-City area.

During the 2012 Lead and Copper Rule sampling conducted at customers' taps, lead was not detected at the 90th percentile level. However, please read the important article below to learn more about lead.

A NOTE ABOUT LEAD FROM THE U.S. ENVIRONMENTAL PROTECTION AGENCY

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Alameda County Water District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (800-426-4791) or at www.epa.gov/safewater/lead.

QUARRY LAKES LEAD FISHING TACKLE EXCHANGE PROGRAM

Late in 2012, ACWD and the East Bay Regional Park District (EBRPD) reached a milestone: after 10 years, over 1,000 pounds of lead fishing tackle had been collected and recycled at Quarry Lakes Regional Recreation Area in Fremont, where lead tackle is prohibited.

Believed to be the first fishing weight exchange program of its kind on the West Coast, the program allows anglers to exchange their toxic lead weights and sinkers for lead-free alternatives. This, in turn, protects wildlife, especially birds, that may ingest lead fishing tackle lost by anglers. Once ingested, the lead can cause poisoning that may result in health impacts ranging from weight loss to death.

In addition to endangering wildlife, lead weights and sinkers can contaminate an important local water supply. Water from the Quarry Lakes filters down into the Niles Cone Groundwater Basin, which supplies the Tri-City area with up to 40% of its drinking water. The exchange program helps to keep lead from entering the lakes and therefore your tap water.

The exchange program is operated by EBRPD staff from the Quarry Lakes entrance kiosk when time permits.

On one Saturday each month during peak fishing season (September through May), a lead fishing weight exchange booth is set up and operated by volunteers. Visit www.ebparks.org/parks/quarry_lakes or call 510-544-3130 for more information.



KEEP AN EYE OUT FOR ACWD'S PUBLIC HEALTH GOALS REPORT

A Public Health Goal (PHG) is the level of a contaminant in drinking water below which there is no known or expected risk to health. Every three years, ACWD is required to prepare a report regarding these goals. This report is intended to provide you with specific information regarding drinking water safety and the cost of further reducing contaminant levels to bring them closer to public health goals.

The Public Health Goals Report documents the drinking water contaminants in our water supply that were found to be above state PHGs or federal Maximum Contaminant Level Goals (MCLGs) during 2010, 2011, and 2012. PHGs and MCLGs are non-enforceable goals set by the California Department of Public Health and the U.S. Environmental Protection Agency, respectively. Although these goals are not enforceable, ACWD strives to meet them in an effort to supply you with the highest quality water possible. From an economic and technological point of view, PHGs are often not practically achievable. Nevertheless, they can be useful tools for regulators when revising enforceable standards.

ACWD's 2012 PHG report will be available in July 2013. For further information, please visit www.acwd.org or contact Kwame Agyare, Water Supply & Production Manager, at (510) 668-6540.

Where Our Water Comes From

ACWD supplies water to the Tri-City area from four sources.

- Treated surface water is imported from the Sacramento/San Joaquin Delta and/or Lake Del Valle via the South Bay Aqueduct. This water is purified at our surface water treatment plants and then delivered to customers living in central and south Fremont.

- Purchased San Francisco water is surface water which originates in either Hetch Hetchy Reservoir in Yosemite National Park, or locally in Calaveras or San Antonio Reservoirs in the Alameda Creek watershed. Hetch Hetchy water meets all federal and state criteria for watershed protection, disinfection treatment, bacteriological quality, and operational standards and has thus been granted a filtration exemption by the USEPA and the CDPH. Water from the local reservoirs is treated at a water treatment plant. Water from the San Francisco system is normally delivered through Hetch Hetchy Aqueduct connections in Fremont. Additional connections in Fremont and Newark may be used to meet peak summer water demands and in times of emergency.

- Blended water consists of a combination of purchased San Francisco water and local groundwater. The groundwater supply comes from the Niles Cone Groundwater Basin which underlies the Tri-City area and is replenished through infiltration from local rainwater, runoff from the Alameda Creek watershed, and water from the South Bay Aqueduct. Purchased San Francisco water is blended with Peralta/Tyson and Mowry Wellfield water at our Blending Facility and is delivered to customers living in north Fremont, Union City, and parts of Newark.

- Desalted or desalinated water is produced at the Newark Desalination Facility (NDF) from brackish (slightly salty) local groundwater. The desalinated water produced by the NDF is blended with Aquifer Reclamation Program well water to achieve a more balanced mineral content before being delivered to customers living in Newark.

Typical Distribution System Map

Your location in the Tri-City area determines the type of water you receive.



Your Views Are Welcome

Meetings of ACWD's Board of Directors typically begin at 6:00 p.m. on the second Thursday of each month and are open to the public. Meetings are held in the ACWD Board Room at the District's headquarters at 43885 South Grimmer Boulevard in Fremont. Further information regarding the Board meeting schedule can be found on our website at: www.acwd.org/index.aspx?nid=351.

If you have any questions or need any more information about the quality of your water, please let us know. We would also appreciate any comments you have about this report. We can be reached by phone at (510) 668-4200, fax (510) 770-1793, on the Internet at www.acwd.org, or by mail at: Alameda County Water District, P.O. Box 5110, Fremont, CA 94537. Kwame Agyare, Water Supply and Production Manager, can be reached at (510) 668-6540.

2012 Water Quality Report

A publication of the Alameda County Water District

Board of Directors

Jim Gunther, President
 Paul Sethy, Vice President
 Judy Huang
 Marty Koller
 John H. Weed

Business Office:

43885 South Grimmer Blvd.
 Fremont, CA 94538
 (510) 668-4200
www.acwd.org

