



La Bonita Park Water Facility



City of _____
La Habra
_____ Water Division

2013 Water Quality Report

Water Conservation is Important: A Little Effort Can Save a Lot

The La Habra Water Division promotes the conservation of water to its residents so that the City can save this scarce resource and save the residents money in the process.

Water is brought to Southern California via large aqueduct systems that feed off of rivers from the Central Valley and the Colorado River. There are large costs involved in maintaining these systems and transporting the water over miles of deserts, valleys and mountain ranges. The MWDSC is the main supplier of this water and controls the vast network of aqueducts, pumping stations and filtration plants.

Local municipal water suppliers do have the ability to tap into underground aquifers, but this local supply of water is not enough to meet the demands of the residents; the more expensive “aqueduct” water must be used to meet the demand. For these reasons, it is recommended that you conserve water by reducing water waste. This will save you money as well. To get you started, here are a few tips that will have you saving water right away.



- **Fix leaky faucets.** For every leak stopped, you can save 20 gallons of water per day.
- **Develop a watering schedule for your irrigation system.** To learn more, visit www.bewaterwise.com/calculator.html.
- **Use native plants in your landscaping.** Planting and maintaining beautiful California native and water-friendly plants can save between 1,000 and 1,800 gallons per month.
- **Install a high efficiency toilet or clothes washer.** A temporary rebate program is still available. Other rebates are also available for sprinklers and artificial turf. (To learn more about these programs, visit www.mwdoc.com/Water_Use_Efficiency.html.)
- **Install a new Smart Sprinkler Controller.** These new controllers figure out the right amount of water for your landscape based on information about your plants and garden environment. These new controllers may save up to 40 gallons per day. A temporary rebate program is still available. (To learn more, visit www.mwdoc.com/Water_Use_Efficiency.html.)

MWDSC has its own water conservation website. To find out more information on water saving plants and other useful tips, visit www.bewaterwise.com.

We Go to Great Lengths to Ensure the Continued Quality of Your Water

Drinking Water Quality

Since 1990, California public water utilities have been providing an annual Water Quality Report to their customers. This year's report covers calendar year 2012 drinking water quality testing and reporting. Your City of La Habra Water Division (City) vigilantly safeguards its water supply and, as in years past, the water delivered to your home meets the quality standards required by federal and state regulatory agencies. The U.S. Environmental Protection Agency (USEPA) and the California Department of Public Health (CDPH) are the agencies responsible for establishing and enforcing drinking water quality standards.

In some cases, the City goes beyond what is required by testing for unregulated chemicals that may have known health risks but do not have drinking water standards. For example, the California Domestic Water Company (Cal Domestic), which supplies the City with treated groundwater, and the Metropolitan Water District of Southern California (MWDSC), which supplies treated imported surface water to the City, test weekly for unregulated chemicals in our water supply. Unregulated chemical monitoring helps USEPA and CDPH determine where certain chemicals occur and whether new standards need to be established for those chemicals to protect public health.

Through the drinking water quality testing programs carried out by Cal Domestic for our groundwater, MWDSC for imported surface water and the City for our water distribution system, your drinking water is constantly monitored from source to tap for regulated and unregulated constituents.

The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old.



Water bound for Southern California meanders through the Delta on its way to the State Water Project.

Sources of Supply


Your drinking water is a blend of surface water imported by MWDSC, and groundwater imported from Cal Domestic and two wells within the City. Cal Domestic water originates from the Main San Gabriel groundwater basin. MWDSC's imported water sources are the Colorado River and the State Water Project, which draws water from the Sacramento-San Joaquin River Delta.

Basic Information About Drinking Water Contaminants

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of land or through the layers of the ground it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animal and human activity.

Contaminants that may be present in source water include:

- ▶ Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses.

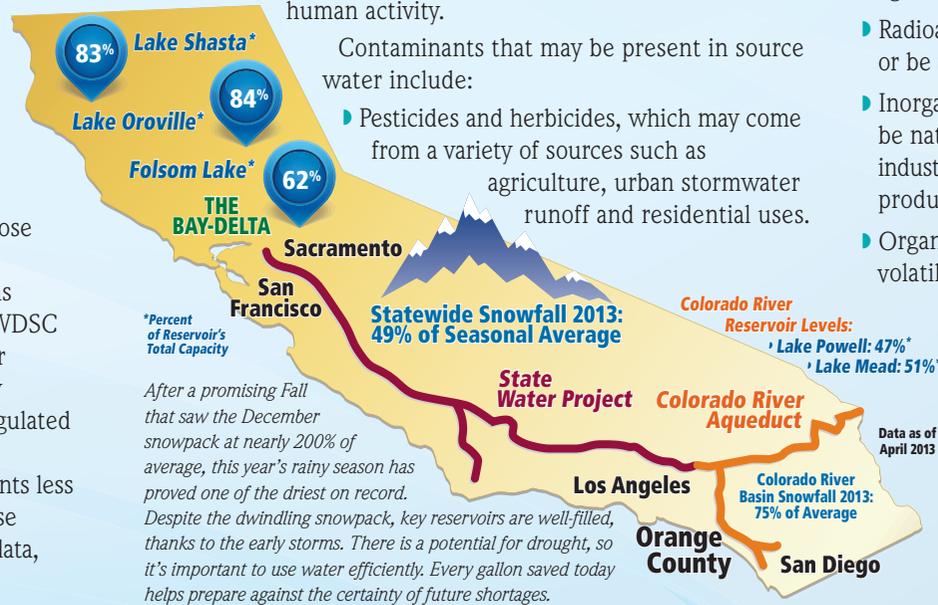

Questions about your water? Contact us for answers.


For information about this report, or your water quality in general, please contact Brian Jones, Water and Sewer Manager, at (562) 905-9792.

The La Habra City Council meets at 6:30 p.m. on the first and third Mondays of each month in the Council Chambers at 201 East La Habra Boulevard. Public attendance and participation is encouraged and welcomed.

For more information about the health effects of the listed constituents in the following tables, call the USEPA hotline at (800) 426-4791.

How Residential Water is Used in Orange County

Outdoor watering of lawns and gardens makes up approximately 60% of home water use. By cutting your outdoor watering by 1 or 2 days a week, you can dramatically reduce your overall water use.

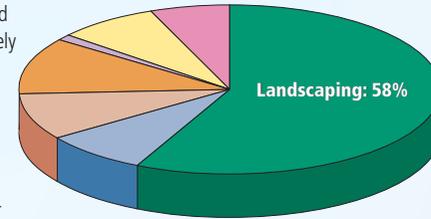

Visit www.bewaterwise.com for water saving tips and ideas for your home and business.

Showers & Baths: 8% Toilets: 11% Leaks: 7%
 Clothes Washers: 9% Dishwashers: 1% Faucets: 6%

- ▶ Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.
- ▶ Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production or mining activities.
- ▶ Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm runoff, industrial or domestic wastewater discharges, oil and gas production, mining and farming.
- ▶ Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gasoline stations, urban stormwater runoff, agricultural application and septic systems.

In order to ensure that tap water is safe to drink, USEPA and the CDPH prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. CDPH regulations also establish limits for contaminants in bottled water

that must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at (800) 426-4791 between 10 a.m. and 4 p.m. Eastern Time (7 a.m. to 1 p.m. in California).



The Quality of Your Water is Our Primary Concern

About Lead in Tap Water

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing.

The City is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking.

If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at: <http://water.epa.gov/drink/info/lead/index.cfm>.

Drinking Water Fluoridation

Fluoride has been added to U.S. drinking water supplies since 1945. Of the 50 largest cities in the U.S., 43 fluoridate their drinking water. In December 2007, the MWDC joined a majority of the nation's public water suppliers in adding fluoride to drinking water in order to prevent tooth decay. In line with recommendations from the CDPH, as well as the U.S. Centers for Disease Control and Prevention, MWDC adjusted the natural fluoride level in imported treated water from the Colorado River and State Project water to the optimal range for dental



health of 0.7 to 1.3 parts per million. Our local water is not supplemented with fluoride. Fluoride levels in drinking water are limited under California state regulations at a maximum dosage of 2 parts per million.

There are many places to go for additional information about the fluoridation of drinking water.

What are Water Quality Standards?

Drinking water standards established by USEPA and CDPH set limits for substances that may affect consumer health or aesthetic qualities of drinking water. The chart in this report shows the following types of water quality standards:

- ▶ **Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible.
- ▶ **Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- ▶ **Secondary MCLs** are set to protect the odor, taste, and appearance of drinking water.
- ▶ **Primary Drinking Water Standard:** MCLs for contaminants that affect health along with their monitoring and reporting requirements and water treatment requirements.
- ▶ **Regulatory Action Level (AL):** The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements that a water system must follow.

How are Contaminants Measured?

Water is sampled and tested throughout the year. Contaminants are measured in:

- ▶ parts per million (ppm) or milligrams per liter (mg/L)
- ▶ parts per billion (ppb) or micrograms per liter (µg/L)
- ▶ parts per trillion (ppt) or nanograms per liter (ng/L)

What is a Water Quality Goal?

In addition to mandatory water quality standards, USEPA and CDPH have set voluntary water quality goals for some contaminants. Water quality goals are often set at such low levels that they are not achievable in practice and are not directly measurable. Nevertheless, these goals provide useful guideposts and direction for water management practices. The chart in this report includes three types of water quality goals:

- ▶ **Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by USEPA.
- ▶ **Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- ▶ **Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

2012 City of La Habra Drinking Water Quality Local Groundwater and Metropolitan Water District Treated Surface Water

Chemical	MCL	PHG (MCLG)	Avg. Groundwater Amount	Avg. Imported MWD Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
Organic Chemicals – Tested in 2012/13							
Tetrachloroethylene, PCE (ppb)	5	0.06	<0.5	ND	ND – 6.5	No	Industrial Waste Discharge
Trichloroethylene, TCE (ppb)	5	1.7	0.65	ND	ND – 13	No	Industrial Waste Discharge
Radiologicals – Tested in 2006, 2008, 2011, and 2012/13							
Alpha Radiation (pCi/L)	15	(0)	6.1	3	ND – 13	No	Erosion of Natural Deposits
Beta Radiation (pCi/L)	50	(0)	ND	ND	ND – 4	No	Decay of Man-made or Natural Deposits
Uranium (pCi/L)	20	0.43	1.3	2	ND – 5	No	Erosion of Natural Deposits
Inorganic Chemicals – Tested in 2012/13							
Aluminum (ppm)	1	0.6	ND	0.15	ND – 0.34	No	Treatment Process Residue, Natural Deposits
Arsenic (ppb)	10	0.004	<2	ND	ND – 2.2	No	Erosion of Natural Deposits
Barium (ppm)	1	2	<0.1	ND	ND – 0.12	No	Erosion of Natural Deposits
Fluoride (ppm) naturally-occurring	2	1	0.42	NR	0.31 – 0.55	No	Erosion of Natural Deposits
Fluoride (ppm) treatment-related	Control Range 0.7 – 1.3 ppm Optimal Level 0.8 ppm		NR	0.8	0.7 – 0.8	No	Water Additive for Dental Health
Nitrate as NO ₃ (ppm)	45	45	8.7	ND	ND – 20	No	Agriculture Runoff and Sewage
Nitrate + Nitrite as N (ppm)	10	10	2.1	ND	ND – 3.8	No	Agriculture Runoff and Sewage
Perchlorate (ppb)	6	6	<4	ND	ND – 3.6	No	Industrial Waste Discharge
Secondary Standards* – Tested in 2012/13							
Aluminum (ppb)	200*	600	ND	150	ND – 340	No	Treatment Process Residue, Natural Deposits
Chloride (ppm)	500*	n/a	68	90	18 – 140	No	Runoff or Leaching from Natural Deposits
Color (color units)	15*	n/a	ND	1	ND – 1	No	Runoff or Leaching from Natural Deposits
MBAS – Surfactants (ppb)	500*	n/a	30	ND	ND – 120	No	Municipal and Industrial Waste Discharge
Odor (threshold odor number)	3*	n/a	1.5	2	1 – 4	No	Naturally-occurring Organic Materials
Specific Conductance (µmho/cm)	1,600*	n/a	910	780	340 – 1,500	No	Substances that Form Ions in Water
Sulfate (ppm)	500*	n/a	130	160	45 – 250	No	Runoff or Leaching from Natural Deposits
Total Dissolved Solids (ppm)	1,000*	n/a	550	500	290 – 920	No	Runoff or Leaching from Natural Deposits
Turbidity (NTU)	5*	n/a	0.13	ND	ND – 0.3	No	Runoff or Leaching from Natural Deposits
Unregulated Chemicals – Tested in 2008 and 2012/13							
Alkalinity, total as CaCO ₃ (ppm)	Not Regulated	n/a	230	98	53 – 310	n/a	Runoff or Leaching from Natural Deposits
Boron	NL = 1,000	n/a	270	130	ND – 740	n/a	Runoff or Leaching from Natural Deposits
Calcium (ppm)	Not Regulated	n/a	63	51	49 – 70	n/a	Runoff or Leaching from Natural Deposits
Hardness, total as CaCO ₃ (ppm)	Not Regulated	n/a	250	210	84 – 300	n/a	Runoff or Leaching from Natural Deposits
Hardness, total (grains/gal)	Not Regulated	n/a	14	12	4.9 – 18	n/a	Runoff or Leaching from Natural Deposits
Magnesium (ppm)	Not Regulated	n/a	22	21	12 – 36	n/a	Runoff or Leaching from Natural Deposits
N-Nitrosodimethylamine (ppt)	NL = 10	n/a	<2	ND	ND – 2.1	n/a	Treated Wastewater; Industrial Waste Discharge
pH (pH units)	Not Regulated	n/a	7.6	8.1	7.4 – 8.4	n/a	Hydrogen Ion Concentration
Potassium (ppm)	Not Regulated	n/a	4.3	4	3.4 – 5.2	n/a	Runoff or Leaching from Natural Deposits
Sodium (ppm)	Not Regulated	n/a	100	80	15 – 200	n/a	Runoff or Leaching from Natural Deposits
tert-Butyl alcohol (ppb)	NL = 12	n/a	<2	ND	ND – 3.4	n/a	Industrial Waste Discharge
Total Organic Carbon (ppm)	Not Regulated	TT	NR	2.4	2 – 2.7	n/a	Various Natural and Man-made Sources

ppb = parts-per-billion; ppm = parts-per-million; ppt = parts-per-trillion; pCi/L = picoCuries per liter; NTU = nephelometric turbidity units; µmho/cm = micromhos per centimeter; NR = not required to be tested; ND = not detected; NL = Notification Level; < = average is less than the detection limit for reporting purposes; MCL = Maximum Contaminant Level; (MCLG) = federal MCL Goal; PHG = California Public Health Goal; n/a = not applicable; TT = treatment technique *Contaminant is regulated by a secondary standard.

Turbidity – combined filter effluent Metropolitan Water District Diemer Filtration Plant	Treatment Technique	Turbidity Measurements	TT Violation?	Typical Source of Contaminant
1) Highest single turbidity measurement	0.3 NTU	0.04	No	Soil Runoff
2) Percentage of samples less than 0.3 NTU	95%	100%	No	Soil Runoff

Turbidity is a measure of the cloudiness of the water, an indication of particulate matter, some of which might include harmful microorganisms. Low turbidity in Metropolitan's treated water is a good indicator of effective filtration. Filtration is called a "treatment technique" (TT). A treatment technique is a required process intended to reduce the level of contaminants in drinking water that are difficult and sometimes impossible to measure directly.

**U.S. Centers
for Disease Control and Prevention**

www.cdc.gov/fluoridation//

**California Department
of Public Health**

[www.cdph.ca.gov/certlic/drinkingwater/
Pages/Fluoridation.aspx](http://www.cdph.ca.gov/certlic/drinkingwater/Pages/Fluoridation.aspx)

American Water Works Association

www.awwa.org


For more information about MWDSC's fluoridation program, please contact Edgar G. Dymally at (213) 217-5709 or at edymally@mwdh2o.com.

How to Read Your Water Meter

Your water meter is usually located between the sidewalk and curb under a cement cover. Remove the cover by inserting a screwdriver in the hole in the lid and then carefully lift the cover.

The meter reads straight across, like the odometer on your car. Read only the black numbers (0895).

If you are trying to determine if you have a leak, turn off all the water in your home, both indoor and out-




door faucets, and then check the dial for any movement of the low-flow indicator. If there is movement, that indicates a leak between the meter and your plumbing system.

- ① **Low-Flow Indicator** ~ The low flow indicator will spin if any water is flowing through the meter.
- ② **Sweep Hand** ~ Each full revolution of the sweep hand indicates that one cubic foot of water (7.48 gallons) has passed through the meter. The markings at the outer edge of the dial indicate tenths and hundredths of one cubic foot.
- ③ **Meter Register** ~ The meter register is a lot like the odometer on your car. The numbers keep a running total of all the water that has passed through the meter. The register shown here indicates that 89,505 cubic feet of water has passed through this meter.

Source Water Assessments

**Imported (MWDSC)
Water Assessment**

Every five years, MWDSC is required by CDPH to examine possible sources of drinking water contamination in its State Water Project and Colorado River source waters.

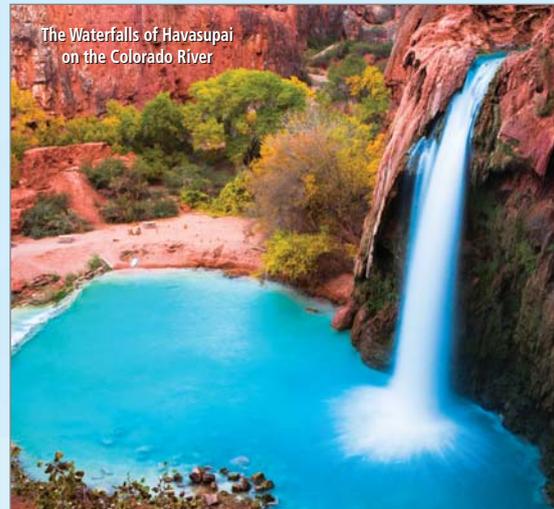

In 2012, MWDSC submitted to CDPH its updated Watershed Sanitary Surveys for the Colorado River and State Water Project, which include suggestions for how to better protect these source waters. Both source waters are exposed to stormwater runoff, recreational activities, wastewater discharges, wildlife, fires, and other watershed-related factors that could affect water quality.

Water from the Colorado River is considered to be most vulnerable to contamination from recreation, urban/stormwater runoff, increasing urbanization in the watershed, and wastewater. Water supplies from Northern California's State Water Project are most vulnerable to contamination from urban/ stormwater runoff, wildlife, agriculture, recreation, and wastewater.

USEPA also requires MWDSC to complete one Source Water Assessment (SWA) that utilizes information collected in the watershed sanitary surveys. MWDSC completed its SWA in December 2002. The SWA is used to evaluate the vulnerability of water sources to contamination and helps determine whether more protective measures are needed.

A copy of the most recent summary of either Watershed Sanitary Survey or the SWA can be obtained by calling MWDSC at (213) 217-6850.

Groundwater Assessment

An assessment of the drinking water sources for the City was completed in December 2010 by City Staff. The sources are considered most vulnerable to the following activities associated with contaminants not detected in the water supply: body shops, gas stations, machine shops, metal plating/finishing/fabricating, repair shops, and sewer collection systems.

A copy of the complete assessment is available at Department of Public Health Office of Drinking Water, Santa Ana District, 28 Civic Center Plaza, Room 325, Santa Ana, California 92701. You may request a summary of the assessment by contacting the City at (562) 905-9792.

Want Additional Information? There's a wealth of information on the internet about Drinking Water Quality and water issues in general. Some good sites — both local and national — to begin your own research are:

City of La Habra: www.lahabracity.com • **Municipal Water District of Orange County:** www.mwdoc.com

Main San Gabriel Basin Watermaster:: www.watermaster.org • **Water Education Foundation:** www.watereducation.org

Metropolitan Water District of Southern California: www.mwdh2o.com

California Department of Public Health, Division of Drinking Water and Environmental Management:
www.cdph.ca.gov/certlic/drinkingwater/Pages/default.aspx

U.S. Environmental Protection Agency: www.epa.gov/safewater

California Department of Water Resources: www.water.ca.gov

Water Conservation Tips: www.bewaterwise.com • www.wateruseitwisely.com

2012 City of La Habra Distribution System Water Quality

Disinfection Byproducts	MCL (MRDL/MRDLG)	Average Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
Total Trihalomethanes (ppb)	80	33	ND – 66	No	Byproducts of Chlorine Disinfection
Haloacetic Acids (ppb)	60	10	ND – 29	No	Byproducts of Chlorine Disinfection
Chlorine Residual (ppm)	(4 / 4)	1.2	0.1 – 2.7	No	Disinfectant Added for Treatment
Aesthetic Quality					
Odor (threshold odor number)	3*	2	1 – 4	No	Erosion of Natural Deposits
Turbidity (NTU)	5*	0.2	0.2	No	Erosion of Natural Deposits

Eight locations in the distribution system are tested quarterly for total trihalomethanes and haloacetic acids, and thirty monthly for color, odor and turbidity. Color was not detected in 2012.

MRDL = Maximum Residual Disinfectant Level; MRDLG = Maximum Residual Disinfectant Level Goal; NTU = nephelometric turbidity units; ND = not detected

*Contaminant is regulated by a secondary standard to maintain aesthetic qualities.

Bacterial Quality	MCL	MCLG	Highest Monthly Positive Samples	MCL Violation?	Typical Source of Contaminant
Total Coliform Bacteria	5%	0	2.9%	No	Naturally Present in the Environment

No more than 5% of the monthly samples may be positive for total coliform bacteria.

The occurrence of 2 consecutive total coliform positive samples, one of which contains fecal coliform/E. coli, constitutes an acute MCL violation.

Lead and Copper Action Levels at Residential Taps

Action Level (AL)	Public Health Goal	90 th Percentile Value	Sites Exceeding AL / Number of Sites	AL Violation?	Typical Source of Contaminant
Lead (ppb)	0.2	6.2	0 / 30	No	Corrosion of Household Plumbing
Copper (ppm)	0.3	0.25	0 / 30	No	Corrosion of Household Plumbing

Every three years 30 residences are tested for lead and copper at-the-tap. The most recent set of samples was collected in 2012.

Lead was detected in 5 homes; none exceeded the regulatory action level (AL). Copper was detected in 19 homes; none exceeded the copper AL.

A regulatory action level is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

ON THE COVER

La Bonita Park Water Facility

Completed in Fall 2012, the La Bonita Park Water Facility now pumps water from beneath the City of La Habra for only a quarter of the cost the city previously paid for imported water from the Municipal Water District of Orange County (MWDOC).



The Facility blends water purchased from Cal Domestic Water Company and our own La Habra Basin Groundwater. The five pumps shown on the front cover lift the water from an underground reservoir and distribute it to homes and businesses throughout the City.

This is all part of an ambitious plan by the Water Division to reduce the City's dependence on costly imported water. When a planned third well, at Portola Park, is completed, the City will get 43% of its water from the ground, and just 10% from MWDOC.



City of La Habra

Water Division
201 E. La Habra Boulevard
La Habra, California 90633-0337



This report contains important information about your drinking water.

Translate it, or speak with someone who understands it.

Bản báo cáo có ghi những chi tiết quan trọng về phẩm chất nước trong cộng đồng quý vị. Hãy nhờ người thông dịch, hoặc hỏi một người bạn biết rõ về vấn đề này.

Este informe contiene información muy importante sobre su agua potable. Para más información ó traducción, favor de contactar a Customer Service Representative. Telefono: (562) 905-9792.

이 보고서에는 귀하가 거주하는 지역의 수질에 관한 중요한 정보가 들어 있습니다. 이것을 번역하거나 충분히 이해하시는 친구와 상의하십시오.

这份报告中有些重要的信息，讲到关于您所在社区的水的品质。请您找人翻译一下，或者请能看得懂这份报告的朋友给您解释一下。

Mahalaga ang impormasyong ito. Mangyaring ipasalin ito.

この資料には、あなたの飲料水についての大切な情報が書かれています。内容をよく理解するために、日本語に翻訳して読むか説明を受けてください。