

2015 Consumer Confidence Report

Water System Name: Elkhorn Road WS #4 270.0579 Report Date: 3/23/2016

We test the drinking water quality for many constituents as required by state and federal regulations. This report shows the results of our monitoring for the period of January 1 - December 31, 2015 and may include earlier monitoring data.

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo ó hable con alguien que lo entienda bien.

Type of water source(s) in use: One underground well

Name & general location of source(s): Elkhorn Water #4, located off Hidden Valley Road, Watsonville, CA

Drinking Water Source Assessment information: N/A

Time and place of regularly scheduled board meetings for public participation: Prunedale Library Community Meeting Room: 17822 Moro Road, Salinas, CA 93907. Meetings scheduled as needed, at member request.

For more information, contact: Bill Fenwick Phone: (831)768-7300

TERMS USED IN THIS REPORT

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency (USEPA).

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Primary Drinking Water Standards (PDWS): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Secondary Drinking Water Standards (SDWS): MCLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Variations and Exemptions: State Board permission to exceed an MCL or not comply with a treatment technique under certain conditions.

ND: not detectable at testing limit

ppm: parts per million or milligrams per liter (mg/L)

ppb: parts per billion or micrograms per liter (µg/L)

ppt: parts per trillion or nanograms per liter (ng/L)

ppq: parts per quadrillion or picogram per liter (pg/L)

pCi/L: picocuries per liter (a measure of radiation)

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- *Microbial contaminants*, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- *Inorganic contaminants*, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- *Pesticides and herbicides*, that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- *Organic chemical contaminants*, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- *Radioactive contaminants*, that can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the USEPA and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Board regulations also establish limits for contaminants in bottled water that provide the same protection for public health.

Tables 1, 2, 3, 4, 5, 7, and 8 list all of the drinking water contaminants that were detected during the most recent sampling for the constituent. The presence of these contaminants in the water does not necessarily indicate that the water poses a health risk. The State Board allows us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of the data, though representative of the water quality, are more than one year old.

TABLE 1 – SAMPLING RESULTS SHOWING THE DETECTION OF COLIFORM BACTERIA

Microbiological Contaminants (complete if bacteria detected)	Highest No. of Detections	No. of months in violation	MCL	MCLG	Typical Source of Bacteria
Total Coliform Bacteria	(In a mo.) <u>4</u>	3	More than 1 sample in a month with a detection	0	Naturally present in the environment
Fecal Coliform or <i>E. coli</i>	(In the year) <u>1</u>	1	A routine sample and a repeat sample detect total coliform and either sample also detects fecal coliform or <i>E. coli</i>	0	Human and animal fecal waste

TABLE 2 – SAMPLING RESULTS SHOWING THE DETECTION OF LEAD AND COPPER

Lead and Copper (complete if lead or copper detected in the last sample set)	Sample Date	No. of samples collected	90 th percentile level detected	No. sites exceeding AL	AL	PHG	Typical Source of Contaminant
Lead (ppb)	4/24/2013	4	ND	0	15	0.2	Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits
Copper (ppm)	4/24/2013	4	0.2	0	1.3	0.3	Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives

TABLE 3 – SAMPLING RESULTS FOR SODIUM AND HARDNESS

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	MCL	PHG (MCLG)	Typical Source of Contaminant
Sodium (ppm)	12/15/2015	35		none	none	Salt present in the water and is generally naturally occurring
Hardness (ppm)	12/15/2015	86		none	none	Sum of polyvalent cations present in the water, generally magnesium and calcium, and are usually naturally occurring

*Any violation of an MCL or AL is asterisked. Additional information regarding the violation is provided later in this report.

TABLE 4 – DETECTION OF CONTAMINANTS WITH A PRIMARY DRINKING WATER STANDARD

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	MCL [MRDL]	PHG (MCLG) [MRDLG]	Typical Source of Contaminant
Fluoride (ppm)	6/9/2013	0.17		2.0	1	Erosion of natural deposits; water additive which promotes strong teeth; discharge from fertilizer and aluminum factories
Nitrate (as Nitrogen, N)	11/10/2015	7.3	6.5-8.0	10	10	Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits
Gross Alpha (pCi/L)	11/28/2011	1.67		15	(0)	Decay of natural and man-made deposits

TABLE 5 – DETECTION OF CONTAMINANTS WITH A SECONDARY DRINKING WATER STANDARD

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	MCL	PHG (MCLG)	Typical Source of Contaminant
Turbidity (Units)	12/15/2015	0.10		5	none	Soil runoff
Chloride (ppm)	12/15/2015	45		500	none	Runoff/leaching from natural deposits; seawater influence
Conductivity (umho/cm)	12/15/2015	349		1,600	none	Substances that form ions when in water; seawater influence
Sulfate (ppm)	12/15/2015	11		500	none	Runoff/leaching from natural deposits; industrial wastes
Total Dissolved Solids (TDS) (ppm)	12/15/2015	250		1,000	none	Runoff/leaching from natural deposits

*Any violation of an MCL, MRDL, or TT is asterisked. Additional information regarding the violation is provided later in this report.

Additional General Information on Drinking Water

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Nitrate in drinking water at levels above 10 mg/L is a health risk for infants of less than six months of age. Such nitrate levels in drinking water can interfere with the capacity of the infant's blood to carry oxygen, resulting in serious illness; symptoms include shortness of breath and blueness of the skin. Nitrate levels above 10 mg/L may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant women and those with specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask advice from your health care provider.

**Summary Information for Violation of a MCL, MRDL, AL, TT,
or Monitoring and Reporting Requirement**

VIOLATION OF A MCL, MRDL, AL, TT, OR MONITORING AND REPORTING REQUIREMENT				
Violation	Explanation	Duration	Actions Taken to Correct the Violation	Health Effects Language
Coliform Bacteria	Water tests over the MCL	July, October & November, 2015	Multiple investigations, repeat disinfections, temporary chlorinator and water line repairs	Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems.
E-Coli Bacteria	Water tests over the MCL at 121 Hidden Valley	July, 2015	Storage tank was disinfected	Fecal coliforms and <i>E. coli</i> are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Microbes in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a special health risk for infants, young children, some of the elderly, and people with severely compromised immune systems.

Drinking Water Source Assessment

Water System

ELKHORN WS #4

Monterey County

Water Source

WELL 01

Assessment Date

May, 2001

California Department of Health Services
Drinking Water Field Operations Branch
LPA Monterey County

District No.	57
System No.	2700579
Source No.	001
PS Code	2700579-001

Assessment Summary

District Name LPA Monterey County District No. 57 County Monterey
 System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001
 Completed by Dan Wessell Date May, 2001

According to DHS records, this Source is Groundwater. This Assessment was done using the Default Groundwater System Method.

Description of System and Source

The ELKHORN WS #4 is located in north Monterey County and serves several residence off Campagna Way. There are approximately 20 service connections, 3 of which are inactive, serving an estimated population of 60 people.

The drinking water source for the ELKHORN WS #4 water system is one well. General land use is rural residential and agriculture.

Assessment Procedures

The assessment of the source was conducted by the County of Monterey, the LPA office. The following sources of information were used in the assessment: Water system files.

Procedures used to conduct the assessment include: File review, site visit and historical knowledge of the area.

Contents of this Assessment

- | | | |
|---|--|--|
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Assessment Summary |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Vulnerability Summary |
| Yes <input type="checkbox"/> | No <input checked="" type="checkbox"/> | Source Location Form |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Delineation of Water Protection Zones |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Physical Barrier Effectiveness Checklist |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Source Data Sheet |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Inventory of Possible Contaminating Activities |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Vulnerability Ranking |
| Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Assessment Map |

Comments

The zones of delineation and possible contaminating activity inventory is based on a brief field survey, previous information compiled from local county files and general historical knowledge of the area.

It is recommended that future involved parties update and refine this information when appropriate.

Drinking Water Source Assessment and Protection (DWSAP) Program

Vulnerability Summary

District Name LPA Monterey County District No. 57 County Monterey

System Name ELKHORN WS #4 System No. 2700579

Source Name WELL 01 Source No. 001 PS Code 2700579-001

Completed by Dan Wessell Date May, 2001

THE FOLLOWING INFORMATION MUST BE INCLUDED IN THE SYSTEM CONSUMER CONFIDENCE REPORT

A source water assessment was conducted for the WELL 01
of the ELKHORN WS #4 water system in May, 2001

The source is considered most vulnerable to the following activities not associated with any detected contaminants:

Septic systems - high density

Discussion of Vulnerability

There is limited well data for this source. The water system should submit a well drillers report to the Monterey County Health Department or any other useful information that it may have, e.g. results of source capacity test, etc..

A copy of the complete assessment may be viewed at:

MontereyCounty Health Department
1270 Natividad Road
Room 102
California, CA 93906

You may request a summary of the assessment be sent to you by contacting:

District Environmental Health Specialist
(831) 755-4507

Drinking Water Source Assessment and Protection (DWSAP) Program

Delineation of Water Protection Zones

District Name LPA Monterey County District No. 57 County Monterey
 System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001
 Completed by Dan Wessell Date May, 2001

Method Used to Delineate Protection Zones

X 1. Calculated Fixed Radius

- 2. Modified Calculated Fixed Radius (Attach documentation for direction of ground water flow.)
- 3. More Detailed Methods
- 4. Arbitrary Fixed Radius (For use only by or permission of DHS)

Maximum Pumping Rate of Well (Q)	<u>140</u>	gallons/minute
	<u>226</u>	acre feet/year
	<u>9,837,380</u>	cubic feet/year
Effective Porosity	<u>0.20</u>	<input checked="" type="checkbox"/> Default Value
Screened Interval of Well	<u>10</u>	feet <input type="checkbox"/> Default Value

Protection Zone	Calculated Value	Minimum Value	Radius of Protection Zone
Zone A - 2 Year TOT*	1,770 Feet	600 Feet	1,770 Feet
Zone B5 - 5 Year TOT*	2,798 Feet	1,000 Feet	2,798 Feet
Zone B10 - 10 Year TOT*	3,957 Feet	1,500 Feet	3,957 Feet

*TOT = Time of Travel

Physical Barrier Effectiveness (PBE)

District Name LPA Monterey County District No. 57 County Monterey
 System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001
 Completed by Dan Wessell Date May, 2001

Parameter	Possible Points	This Source	Score
Type of Aquifer Confinement			
1. Unconfined, Semi-confined, Fractured Rock, Unknown Aquifer	0	X	0
2. Confined	50		
Aquifer Material (Unconfined Aquifers)			
Type of material within aquifer			
1. Porous Media (Interbedded sands, silts, clays, gravels) with continuous clay layer minimum 25' thick above water table within Zone A	20		
2. Porous Media (Interbedded sands, silts, clays, gravels)	10	X	10
3. Fractured rock (Low Physical Barrier Effectiveness - no further questions required)	0		
Pathways of Contamination (All Aquifers)			
Presence of Abandoned or Improperly Destroyed Wells			
1. Present within Zone A (2 year TOT distance)	Yes	0	
	No	5	X 5
	Unknown	0	
2. Present within Zone B5 (2 -5 year TOT distance)	Yes	0	
	No	3	
	Unknown	0	X 0
3. Present within Zone B10 (5-10 year TOT distance)	Yes	0	
	No	2	
	Unknown	0	X 0
Static Water Conditions (Unconfined Aquifers)			
Depth to Static Water (DTW) <u>120</u> feet	0 to 20 feet	0	
	20 to 50 feet	2	
	50 to 100 feet	6	
	Greater than 100 feet	10	X 10
	Unknown	0	
Well Operation (Unconfined Aquifers)			
Depth to Uppermost Perforations (DUP) <u>140</u> feet			
Maximum Pumping Rate of Well (Q) <u>140</u> gallons/minute			
Length of Screened Interval (H) <u>10</u> feet [DUP - DTW / Q/H] <u>1.43</u>	Less than 5	0	X 0
	Between 5 and 10	5	
	Greater than 10	10	
	Unknown	0	

Physical Barrier Effectiveness (PBE)

System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001

Parameter		Possible Points	This Source	Score
Well Construction (All Aquifers)				
Sanitary Seal (Annular Seal) Depth <u>0</u> feet	None or less than 20 feet	0	X	0
	Between 20 and 50 feet	6		
	50 feet or greater	10		
	Unknown	0		
Surface Seal (concrete cap)	Not present or improperly constructed	0		
	Watertight, slopes away from well at least 2' laterally in all directions	4	X	4
	Unknown	0		
Flooding potential at well site	Subject to localized flooding (i.e. in low area or unsealed pit or vault) or within 100 year flood plain	0		
	Not subject to flooding	1	X	1
	Unknown	0		
Security at well site	Not secure	0	X	0
	Secure	5		
	Unknown	0		

Score	Effectiveness
0 to 35	Low
36 to 69	Moderate
70 to 100	High

Maximum Score = 70

Score	<u>30</u>
Effectiveness	<u>Low</u>

Drinking Water Source Assessment and Protection (DWSAP) Program

Inventory of Possible Contaminating Activities (PCA Inventory)

District Name LPA Monterey County District No. 57 County Monterey

System Name ELKHORN WS #4 System No. 2700579

Source Name WELL 01 Source No. 001 PS Code 2700579-001

Completed by Dan Wessell Date May, 2001

PCA (Risk Ranking)	PCA in Zone A	PCA in Zone B5	PCA in Zone B10	*	Comments
Residential/Municipal Activities					
Airports - Maintenance/ fueling areas (VH)	N	N	N		
Landfills/dumps (VH)	N	N	N		
Railroad yards/ maintenance/ fueling areas (H)	N	N	N		
Septic systems - high density (>1/acre) (VH in Zone A, otherwise M)	Y	N	N		
Sewer collection systems (H in Zone A, otherwise L)	N	N	N		
Utility stations - maintenance areas (H)	N	N	N		
Wastewater treatment plants (VH in Zone A, otherwise H)	N	N	N		
Drinking water treatment plants (M)	N	N	N		
Golf courses (M)	N	N	N		
Housing - high density (>1 house/0.5 acres) (M)	N	N	N		
Motor pools (M)	N	N	N		
Parks (M)	N	N	N		
Waste transfer/recycling stations (M)	N	N	N		
Apartments and condominiums (L)	N	N	N		
Campgrounds/ Recreational areas (L)	N	N	N		
Fire stations (L)	N	N	N		
RV Parks (L)	N	N	N		
Schools (L)	N	N	N		
Hotels, Motels (L)	N	N	N		
Agricultural/Rural Activities					
Grazing (> 5 large animals or equivalent per acre) (H in Zone A, otherwise M)	N	N	N		
Concentrated Animal Feeding Operations (CAFOs) as defined in federal regulation1 (VH in Zone A, otherwise H)	N	N	N		
Animal Feeding Operations as defined in federal regulation2 (VH in Zone A, otherwise H)	N	N	N		
Other Animal operations (H in Zone A, otherwise M)	N	N	N		
Farm chemical distributor/ application service (H)	N	N	N		
Farm machinery repair (H)	N	N	N		
Septic systems - low density (<1/acre) (H in Zone A,	Y	Y	Y		

Y = Yes N = No U = Unknown

* = A contaminant potentially associated with this activity has been detected in the water supply.

Inventory of Possible Contaminating Activities (PCA Inventory)

System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001

PCA (Risk Ranking)	PCA in Zone A	PCA in Zone B5	PCA in Zone B10	*	Comments
Agricultural/Rural Activities					
otherwise L)					
Lagoons / liquid wastes (H)	N	N	N		
Machine shops (H)	N	N	N		
Pesticide/fertilizer/ petroleum storage & transfer areas (H)	N	N	N		
Agricultural Drainage (H in Zone A, otherwise M)	Y	U	U		
Wells - Agricultural/ Irrigation (H)	Y	U	U		
Managed Forests (M)	N	N	N		
Crops, irrigated (Berries, hops, mint, orchards, sod, greenhouses, vineyards, nurseries, vegetable) (M)	Y	Y	Y		
Fertilizer, Pesticide/ Herbicide Application (M)	Y	Y	Y		
Sewage sludge/biosolids application (M)	N	N	N		
Crops, nonirrigated (e.g., Christmas trees, grains, grass seeds, hay, pasture) (includes drip-irrigated crops) (L)	N	N	N		
Other Activities					
NPDES/WDR permitted discharges (H)	N	N	N		
Underground Injection of Commercial/Industrial Discharges (VH)	N	N	N		
Historic gas stations (VH)	N	N	N		
Historic waste dumps/ landfills (VH)	N	N	N		
Illegal activities/ unauthorized dumping (H)	N	N	N		
Injection wells/ dry wells/ sumps (VH)	N	N	N		
Known Contaminant Plumes (VH)	N	N	N		
Military installations (VH)	N	N	N		
Mining operations - Historic (VH)	N	N	N		
Mining operations - Active (VH)	N	N	N		
Mining - Sand/Gravel (H)	N	N	N		
Wells - Oil, Gas, Geothermal (H)	N	N	N		
Salt Water Intrusion (H)	N	N	N		
Recreational area - surface water source (H)	N	N	N		
Underground storage tanks - Confirmed leaking tanks (VH)	N	N	N		
Underground storage tanks - Decommissioned - inactive tanks (L)	N	N	N		
Underground storage tanks - Non-regulated tanks (tanks	N	N	N		

Y = Yes N = No U = Unknown
 * = A contaminant potentially associated with this activity has been detected in the water supply.

Inventory of Possible Contaminating Activities (PCA Inventory)

System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001

PCA (Risk Ranking)	PCA in Zone A	PCA in Zone B5	PCA in Zone B10	*	Comments
Other Activities					
smaller than regulatory limit) (H)					
Underground storage tanks - Not yet upgraded or registered tanks (H)	N	N	N		
Underground storage tanks - Upgraded and/or registered - active tanks (L)	N	N	N		
Above ground storage tanks (M)	U	U	U		
Wells - Water supply (M)	Y	Y	Y		
Construction/demolition staging areas (M)	N	N	N		
Contractor or government agency equipment storage yards (M)	N	N	N		
Dredging (M)	N	N	N		
Transportation corridors - Freeways/state highways (M)	N	N	N		
Transportation corridors - Railroads (M)	N	N	N		
Transportation corridors - Historic railroad right-of-ways (M)	N	N	N		
Transportation corridors - Road Right-of-ways (herbicide use areas) (M)	N	N	N		
Transportation corridors - Roads/ Streets (L)	Y	Y	Y		
Hospitals (M)	N	N	N		
Storm Drain Discharge Points (M)	N	N	N		
Storm Water Detention Facilities (M)	N	N	N		
Artificial Recharge Projects - Injection wells (potable water) (L)	N	N	N		
Artificial Recharge Projects - Injection wells (non-potable water) (M)	N	N	N		
Artificial Recharge Projects - Spreading Basins (potable water) (L)	N	N	N		
Artificial Recharge Projects - Spreading Basins (non-potable water) (M)	N	N	N		
Medical/dental offices/clinics (L)	N	N	N		
Veterinary offices/clinics (L)	N	N	N		
Surface water - streams/ lakes/rivers (L)	Y	Y	Y		Slough and Swale
Wells - monitoring, test holes (L)	N	N	N		

Y = Yes N = No U = Unknown
 * = A contaminant potentially associated with this activity has been detected in the water supply.

Drinking Water Source Assessment and Protection (DWSAP) Program


Vulnerability Ranking

District Name LPA Monterey County District No. 57 County Monterey
 System Name ELKHORN WS #4 System No. 2700579
 Source Name WELL 01 Source No. 001 PS Code 2700579-001
 Completed by Dan Wessell Date May, 2001

Zone	PCA (Risk Ranking)	*	PCA Risk Points	Zone Points	PBE Points	Vulnerability Score
A	Septic systems - high density (>1/acre) (VH in Zone A, otherwise M)		7	5	5	17
A	Agricultural Drainage (H in Zone A, otherwise M)		5	5	5	15
A	Septic systems - low density (<1/acre) (H in Zone A, otherwise L)		5	5	5	15
A	Wells - Agricultural/ Irrigation (H)		5	5	5	15
A	Crops, irrigated (Berries, hops, mint, orchards, sod, greenhouses, vineyards, nurseries, vegetable) (M)		3	5	5	13
A	Fertilizer, Pesticide/ Herbicide Application (M)		3	5	5	13
A	Wells - Water supply (M)		3	5	5	13
A	Surface water - streams/ lakes/ rivers (L)		1	5	5	11
A	Transportation corridors - Roads/ Streets (L)		1	5	5	11
B5	Crops, irrigated (Berries, hops, mint, orchards, sod, greenhouses, vineyards, nurseries, vegetable) (M)		3	3	5	11
B5	Fertilizer, Pesticide/ Herbicide Application (M)		3	3	5	11
B5	Wells - Water supply (M)		3	3	5	11
B5	Wells - Agricultural/ Irrigation (H)		5	0	5	10
B10	Wells - Agricultural/ Irrigation (H)		5	0	5	10
B5	Septic systems - low density (<1/acre) (H in Zone A, otherwise L)		1	3	5	9
B5	Surface water - streams/ lakes/ rivers (L)		1	3	5	9
B5	Transportation corridors - Roads/ Streets (L)		1	3	5	9
B10	Crops, irrigated (Berries, hops, mint, orchards, sod, greenhouses, vineyards, nurseries, vegetable) (M)		3	1	5	9
B10	Fertilizer, Pesticide/ Herbicide Application (M)		3	1	5	9
B10	Wells - Water supply (M)		3	1	5	9
A	Above ground storage tanks (M)		3	0	5	8
B5	Above ground storage tanks (M)		3	0	5	8
B5	Agricultural Drainage (H in Zone A, otherwise M)		3	0	5	8
B10	Above ground storage tanks (M)		3	0	5	8
B10	Agricultural Drainage (H in Zone A, otherwise M)		3	0	5	8

* = A contaminant potentially associated with this activity has been detected in the water supply.

DWSAP Ground Water Zone Interface

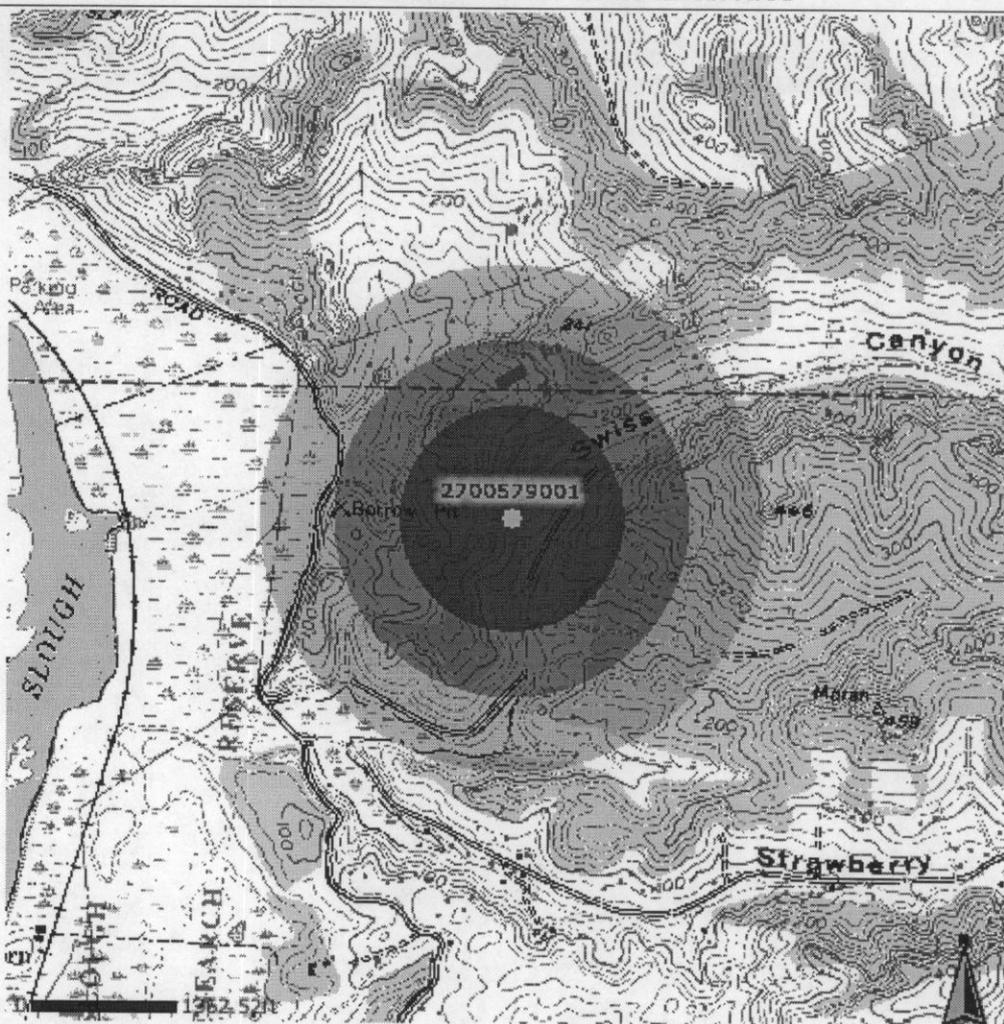

Well Position *	GPS'd	Longitude	Latitude
	Yes	-121.727	36.835

* Well location coordinates have been rounded to 3 decimal places due to security concerns.

Well Statistics	
Well Number	2700579001
Media Type	Porous Media
System Type	All Other System
Effective Porosity (n , decimal percent)	0.2
Screened Interval (H , feet)	10
Pumping Capacity (Q , gpm)	50
Azimuth of Flow (a , degrees)	0 - No Translation

Radii Measures	
Defaults Used	No
R2	1056 ft
R5	1673 ft
R10	2365 ft



© Information Center for the Environment
 Coding by Eric Lehmer
 Mapping System produced using ESRI ArcIMS